

SHELBYVILLE MUNICIPAL WATER & SEWER COMMISSION
P.O. BOX 608
SHELBYVILLE, KY 40065
(502) 633-2840

APPLICATION FORM
FOR
WASTEWATER CONTRIBUTION PERMIT

Note: Please read all attached instructions prior to completing this application.

SECTION A – GENERAL INFORMATION

1. Facility Name:

a. Operator Name:

b. Is the operator identified in 1. a., the owner of the facility?

Yes No

If no, provide the name and address of the operator and submit a copy of the contract and/or other documents indicating the operator's scope of responsibility for the facility.

2. Facility Address:

Street:

City: State: Zip:

3. Business Mailing Address:

Street or P.O. Box:

City: State: Zip:

4. Designated signatory authority of the facility:
(Attach similar information for each authorized representative)

Name:

Title:

Address:

City: State: Zip:

Phone #:

5. Designated facility contact:

Name:

Title:

Phone #:

SECTION B – BUSINESS ACTIVITY

1. If your facility employs or will be employing processes in any of the industrial categories or business activities listed below (regardless of whether they generate wastewater, waste sludge, or hazardous wastes), place a check beside the category of business activity (check all that apply).

Industrial Categories*

- Aluminum Forming
- Asbestos Manufacturing
- Battery Manufacturing
- Can Making
- Carbon Black
- Coal Mining
- Coil Coating
- Copper Forming
- Electric and Electronic Components Manufacturing
- Electroplating
- Feedlots
- Fertilizer Manufacturing
- Foundries (Metal Molding and Casting)
- Glass Manufacturing
- Grain Mills
- Inorganic Chemicals
- Iron and Steel
- Leather Tanning and Finishing
- Metal Finishing
- Nonferrous Metals Forming
- Nonferrous Metals Manufacturing
- Organic Chemicals Manufacturing
- Paint and Ink Formulating
- Paving and Roofing Manufacturing
- Pesticides Manufacturing
- Petroleum Refining
- Pharmaceutical
- Plastic and Synthetic Materials Manufacturing
- Plastics Processing Manufacturing
- Porcelain Enamel
- Pulp, Paper, and Fiberboard Manufacturing
- Rubber
- Soap and Detergent Manufacturing
- Steam Electric
- Sugar Processing
- Textile Mills
- Timber Products

*A facility with processes inclusive in these business areas may be covered by Environmental Protection Agency's (EPA) categorical pretreatment standards. These facilities are termed "categorical users".

2. Give a brief description of all operations at this facility including primary products or services (attach additional sheets if necessary):

3. Indicate applicable Standard Industrial Classification (SIC) for all processes (If more than one applies, list in descending order of importance.):

a.

b.

c.

d.

e.

4. PRODUCT VOLUME:

PRODUCT (Brandname) (levels with others) (and no u. 1)	PAST CALENDAR YEAR AMOUNTS PER DAY (Daily Units)		ESTIMATE THIS CALENDAR YEAR AMOUNTS PER DAY (Daily Units)	
	<u>Average</u>	<u>Maximum</u>	<u>Average</u>	<u>Maximum</u>
<input style="width: 150px; height: 25px;" type="text"/>	<input style="width: 80px; height: 25px;" type="text"/>	<input style="width: 80px; height: 25px;" type="text"/>	<input style="width: 80px; height: 25px;" type="text"/>	<input style="width: 80px; height: 25px;" type="text"/>
<input style="width: 150px; height: 25px;" type="text"/>	<input style="width: 80px; height: 25px;" type="text"/>	<input style="width: 80px; height: 25px;" type="text"/>	<input style="width: 80px; height: 25px;" type="text"/>	<input style="width: 80px; height: 25px;" type="text"/>
<input style="width: 150px; height: 25px;" type="text"/>	<input style="width: 80px; height: 25px;" type="text"/>	<input style="width: 80px; height: 25px;" type="text"/>	<input style="width: 80px; height: 25px;" type="text"/>	<input style="width: 80px; height: 25px;" type="text"/>
<input style="width: 150px; height: 25px;" type="text"/>	<input style="width: 80px; height: 25px;" type="text"/>	<input style="width: 80px; height: 25px;" type="text"/>	<input style="width: 80px; height: 25px;" type="text"/>	<input style="width: 80px; height: 25px;" type="text"/>
<input style="width: 150px; height: 25px;" type="text"/>	<input style="width: 80px; height: 25px;" type="text"/>	<input style="width: 80px; height: 25px;" type="text"/>	<input style="width: 80px; height: 25px;" type="text"/>	<input style="width: 80px; height: 25px;" type="text"/>
<input style="width: 150px; height: 25px;" type="text"/>	<input style="width: 80px; height: 25px;" type="text"/>	<input style="width: 80px; height: 25px;" type="text"/>	<input style="width: 80px; height: 25px;" type="text"/>	<input style="width: 80px; height: 25px;" type="text"/>

SECTION C – WATER SUPPLY

1. Water Sources: (Check as many as are applicable)

- Private Well
- Surface Water
- Municipal Water Utility (Specify City):
- Other (Specify):

2. Name on the water bill:

Name:

Street:

City: State: Zip:

3. List average water usage on premises:
(New facilities may estimate)

<u>Type</u>	Average Water Usage (GPD)	Indicate Estimated (E) or Measured (M)
a. Contract cooling water	<input style="width: 100%;" type="text"/>	<input style="width: 100%;" type="text"/>
b. Non-contract cooling water	<input style="width: 100%;" type="text"/>	<input style="width: 100%;" type="text"/>
c. Boiler feed	<input style="width: 100%;" type="text"/>	<input style="width: 100%;" type="text"/>
d. Process	<input style="width: 100%;" type="text"/>	<input style="width: 100%;" type="text"/>
e. Sanitary	<input style="width: 100%;" type="text"/>	<input style="width: 100%;" type="text"/>
f. Air pollution control	<input style="width: 100%;" type="text"/>	<input style="width: 100%;" type="text"/>
g. Contained in product	<input style="width: 100%;" type="text"/>	<input style="width: 100%;" type="text"/>
h. Plant and equipment washdown	<input style="width: 100%;" type="text"/>	<input style="width: 100%;" type="text"/>
i. Irrigation and lawn watering	<input style="width: 100%;" type="text"/>	<input style="width: 100%;" type="text"/>
j. Other	<input style="width: 100%;" type="text"/>	<input style="width: 100%;" type="text"/>
k. TOTAL OF a – j	<input style="width: 100%;" type="text"/>	<input style="width: 100%;" type="text"/>

SECTION D – SEWER INFORMATION

1. A. For an existing business:

Is the building presently connected to the public sanitary system?

Yes

No

Have you applied for a sanitary sewer hookup?

Yes

No

B. For a new business:

(i). Will you be occupying an existing vacant building (such as in an industrial park)? Yes No

(ii). Have you applied for a building permit if a new facility will be constructed? Yes No

(iii). Will you be connected to the public sanitary sewer systems? Yes No

2. List size, descriptive location and flow of each facility sewer which connects to the City's sewer system. (If more than three, attach additional information on another sheet).

<u>Sewer Size</u>	<u>Descriptive Location of Sewer Connection or Discharge Point</u>	<u>Average Flow (GPD)</u>
<input type="text"/>	<input type="text"/>	<input type="text"/>
<input type="text"/>	<input type="text"/>	<input type="text"/>
<input type="text"/>	<input type="text"/>	<input type="text"/>
<input type="text"/>	<input type="text"/>	<input type="text"/>

SECTION E – WASTEWATER DISCHARGE INFORMATION

1. Does (or will) this facility discharge any wastewater other than from restrooms to the Sewer?

Yes If the answer to this question is “Yes,” complete the remainder of the application.

No If the answer to this question is “No,” skip to Section I.

2. Provide the following information on wastewater flow rate.

(New facilities may estimate)

a. Hours/Day Discharged (e.g., 8 hours/day):

M T W TH F SAT SUN

b. Hours of discharge (e.g., 9 a.m. to 5 p.m.):

M T W TH F SAT SUN

c. Peak hourly flow rate (GPD)

d. Maximum daily flow rate (GPD)

e. Annual daily average (GPD)

3. If batch discharge occurs or will occur, indicate:

(New facilities may estimate)

a. Number of batch discharges /per day

b. Average discharges per batch (GPD)

c. Time of batch discharges at
(days of week) (hours of day)

d. Flow rate gallons/minute

e. Percent of total discharge

4. Schematic Flow Diagram – For each major activity in which wastewater is or will be generated, draw a diagram of the flow of materials, products, water and wastewater from the start of the activity to its completion, showing all unit processes. Indicate which processes use water and which generate wastestreams. Include the average daily volume and maximum daily volume of each wastestream (new facilities may estimate). If estimates are used for flow data this must be indicated. Number each unit process having wastewater discharges to the community sewer. Use these numbers when showing this unit processes in the building layout in Section H. This drawing must be certified by a principal of the facility.
-

Facilities that checked activities in question 1 of Section B are considered Categorical Industrial Users and should skip to question 6.

5. For Non-Categorical Users Only: List average wastewater discharge, maximum discharge and type of discharge (batch, continuous or both), for each plant process. Include the reference number from the process schematic that corresponds to each process. (New facilities should provide estimates for each discharge).

No.	Process Description	Average Flow (GPD)	Maximum Flow (GPD)	Type of Discharge (batch, continuous, none)

ANSWER QUESTIONS 6 & 7 ONLY IF YOU ARE SUBJECT TO CATEGORICAL PRETREATMENT STANDARDS

6. For Categorical Users: Provide the wastewater discharge flows for each of your processes or proposed processes. Include the reference number from the process schematic that corresponds to each process. (New facilities should provide estimates for each discharge).

No.	Regulated Process	Average Flow (GPD)	Maximum Flow (GPD)	Type of Discharge (batch, continuous, none)

No.	Unregulated Process	Average Flow (GPD)	Maximum Flow (GPD)	Type of Discharge (batch, continuous, none)

No.	Dilution	Average Flow (GPD)	Maximum Flow (GPD)	Type of Discharge (batch, continuous, none)

7. For Categorical Users subject to Total Toxic Organic (TTO) Requirements:

Provide the following (TTO) information.

- a. Does (or will) this facility use any of the toxic organics that are listed under the TTO standard of the applicable categorical pretreatment standards published by the EPA?
 Yes
 No

- b. Has a baseline monitoring report (BMR) been submitted which contains TTO information?
 Yes
 No

- c. Has a toxic organics management plan (TOMP) been developed?
 Yes (Please attach a copy)
 No

8. Do you have, or plan to have, automatic sampling equipment or continuous wastewater flow metering equipment at this facility?


- | | | | |
|-------------------------------|---------------------------|--------------------------|---------------------------|
| Current: Flow Metering | <input type="radio"/> Yes | <input type="radio"/> No | <input type="radio"/> N/A |
| Sampling Equipment | <input type="radio"/> Yes | <input type="radio"/> No | <input type="radio"/> N/A |
| Planned: Flow Metering | <input type="radio"/> Yes | <input type="radio"/> No | <input type="radio"/> N/A |
| Sampling Equipment | <input type="radio"/> Yes | <input type="radio"/> No | <input type="radio"/> N/A |

If so, please indicate the present or future location of this equipment on the sewer schematic and describe the equipment below:

9. Are any process changes or expansions planned during the next three years that could alter wastewater volumes or characteristics? Consider production processes as well as air or water pollution treatment processes that may affect the discharge.

- Yes
- No, (skip question 10)


10. Briefly describe these changes and their effects on the wastewater volume and characteristics: (Attach additional sheets if needed.)



11. Are any materials or water reclamation systems in use or planned?

- Yes
 No, (skip question 12)

12. Briefly describe recovery process, substance recovered, percent recovered, and the concentration in the spent solution. Submit a flow diagram for each process: (Attach additional sheets if needed.)



SECTION F– CHARACTERISTICS OF DISCHARGE

All **current industrial users** are required to submit monitoring data on all pollutants that are regulated specific to each process. Use the tables provided in this section to report the analytical results. **DO NOT LEAVE BLANKS**. For all other (non-regulated) pollutants, indicate whether the pollutant is known to be present (P), suspect to be present (S), or known not to be present (O), by placing the appropriate letter in the column for average reported values. Indicate on either the top of each table, or on a separate sheet, if necessary, the sample location and type of analysis used. Be sure methods conform to 40 CFR Part 136, if they do not, indicate what method was used.

New dischargers should use the table to indicate what pollutants will be present or are suspected to be present in proposed wastestreams by placing a P (expected to be present), S (may be present), or O (will not be present) under the average reported values.

SECTION G – TREATMENT

1. Is any form of wastewater treatment (see list below) practiced at this facility?

- Yes
 No

2. Is any form of wastewater treatment (or changes to an existing wastewater treatment) planned for this facility within the next three years?

- Yes, describe:
 No

3. Treatment devices or processes used or proposed for treating wastewater or sludge (check as many as appropriate).

- Air flotation
 Centrifuge
 Chemical precipitation
 Chlorination
 Cyclone
 Filtration
 Flow equalization
 Grease or oil separation, type:
 Grease trap
 Grinding filter
 Grit removal
 Ion exchange
 Neutralization, pH correction
 Ozonation
 Reverse osmosis
 Screen
 Sedimentation
 Septic tank
 Solvent separation
 Spill protection
 Sump
 Biological Treatment, type:
 Rainwater diversion or storage
 Other chemical treatment, type:
 Other physical treatment, type:
 Other, type:

4. Description

Describe the pollutant loadings, flow rates, design capacity, physical size and operating procedures of each treatment facility checked above.

5. Attach a process flow diagram for each existing treatment system. Include process equipment, by-products, by-product disposal method, waste and by-product volumes and design and operating conditions.

6. Describe any changes in treatment or disposal methods planned or under construction for the wastewater discharge to the sanitary sewer. Please include estimated completion dates.

7. Do you have a treatment operator? Yes No

(if yes) Name:

Title:

Phone:

Full time: (specify hours)

Part time: (specify hours)

8. Do you have a manual on the correct operation of your treatment plant?

Yes No

9. Do you have a written maintenance schedule for your treatment equipment?

Yes No

SECTION H – FACILITY OPERATION CHARACTERISTICS

1. Shift Information

Work Days Mon Tue. Wed Thur Fri. Sat. Sun.

Shifts per work day:	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>
Empl's per Shift:	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>
Shift start and end times:	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>

2. Indicate whether the business activity is:

- Continuous through the year, or
 - Seasonal – Select the months of the year during which the business activity occurs:
- J F M A M J J A S O N D

COMMENTS:

3. Indicate whether the facility discharge is:

- Continuous through the year, or
 - Seasonal – Select the months of the year during which the business activity occurs:
- J F M A M J J A S O N D

COMMENTS:

7. Building Layout – Draw to scale the location of each building on the premises. Show map orientation and location of all water meters, storm drains, numbered unit processes (from schematic flow diagram), public sewers and each facility sewer line connected to the public sewers. Number each sewer and show existing and proposed sampling locations. This drawing must be certified by a principal of the facility.

A blueprint or drawing of the facilities showing the above items may be attached in lieu of submitting a drawing on this sheet.

SECTION I – SPILL PREVENTION

1. Do you have chemical storage containers, bins or ponds at your facility?
 Yes No

If yes, please give a description of their location, contents, size, type, and frequency and method of cleaning. Also indicate in a diagram or comment on the proximity of these containers to a sewer or storm drain. Indicate if buried metal containers have cathodic protection.

2. Do you have floor drains in your manufacturing or chemical storage area(s)?
 Yes No

If yes, where do they discharge to?

3. If you have chemical storage containers, bins or ponds in manufacturing area, could an accidental spill lead to a discharge to: (Check all that apply).

- an onsite disposal system
 public sanitary system (e.g. through a floor drain)
 storm drain
 to ground
 other, specify:
 not applicable, no possible discharge to any of the above routes

4. Do you have an accidental spill prevention plan (ASPP) to prevent spills of chemicals or slug discharges from entering the Control Authority's collection systems?

- Yes
 No
 N/A, Not applicable since there are no floor drains and/or the facility discharge(s) only domestic wastes.

5. Please describe below any previous spill events and remedial measures taken to prevent their reoccurrence.

SECTION J – NON-DISCHARGED WASTES

1. Are any waste liquids or sludges generated and not disposed of in the sanitary sewer system?

- Yes, please describe below
- No, skip the remainder of Section J

Waste Generated	Quantity (per year)	Disposal Method

2. Indicate which wastes identified above are disposed of at an off-site treatment facility and which are disposed of on-site.

Offsite	Onsite

3. If any of your wastes are sent to an off-site centralized waste treatment facility, identify the waste and the facility.

Waste	Facility

4. If an outside firm removes any of the above checked wastes, state the name(s) and address(es) of all waste haulers:

<p>a. <input style="width: 100%;" type="text"/></p> <input style="width: 100%;" type="text"/> <input style="width: 100%;" type="text"/>	<p>b. <input style="width: 100%;" type="text"/></p> <input style="width: 100%;" type="text"/> <input style="width: 100%;" type="text"/>
<p>Permit No. <input style="width: 100%;" type="text"/></p> <p>(if applicable): <input style="width: 100%;" type="text"/></p>	<p>Permit No. <input style="width: 100%;" type="text"/></p> <p>(if applicable): <input style="width: 100%;" type="text"/></p>

5. Have you been issued any Federal, State or Local environmental permits?

- Yes
- No

If yes, please list the permit(s):

Authorized Representative Statement:

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

Name(s)

Title

Signature

Date

Phone

INSTRUCTIONS TO FILL OUT WASTEWATER DISCHARGE PERMIT APPLICATION

All questions must be answered. DO NOT LEAVE BLANKS. If you answer “no” to question E.1., you may skip to Section I. Otherwise, if a question is not applicable, indicate so on the form. Instructions to some questions on the permit application are given below.

SECTION A – INSTRUCTIONS (GENERAL INFORMATION)

1. Enter the facility’s official or legal name. Do not use a colloquial name.
 - a. Operator’s Name: Give the name, as it is legally referred to, of the person, firm, public organization, or any other entity which operates the facility described in this application. This may or may not be the same name as the facility.
 - b. Indicate whether the entity which operates the facility also owns it by marking the appropriate box:
 - (i) If the response is “No”, clearly indicate the operator’s name and address and submit a copy of the contract and/or other documents indicating the operator’s scope of responsibility for the facility.
2. Provide the physical location of the facility that is applying for a discharge permit.
3. Provide the mailing address where correspondence from the Control Authority may be sent.
4. Provide all the names of the authorized signatories for this facility for the purposes of signing all reports. The designated signatory is defined as:
 - a. A responsible corporate officer, if the Industrial User submitting the reports is a corporation. For the purpose of this paragraph, a responsible corporate officer means:
 - (i) a president, secretary, treasurer, or vice-president of the corporation in charge of a principal business function, or any other person who performs similar policy- or decision-making functions for the corporation, or

- (ii) the manager of one or more manufacturing, production, or operation facilities employing more than 250 persons or having gross annual sales or expenditures exceeding \$25 million (in second-quarter 1980 dollars), if authority to sign documents has been assigned or delegated to the manager in accordance with corporate procedures.
 - b. A general partner or proprietor if the Industrial User submitting the reports is a partnership or sole proprietorship respectively.
 - c. The principal executive officer or director having responsibility for the overall operation of the discharging facility if the Industrial User submitting the reports is a Federal, State, or Local governmental entity, or their agents.
 - d. A duly authorized representative of the individual designated in paragraph (a), (b) or (c); of this section if:
 - (i) the authorization is made in writing by the individual described in paragraph (a), (b) or (c);
 - (ii) the authorization specifies either an individual or a position having responsibility for the overall operation of the facility from which the Industrial Discharge originates, such as the position of plant manager, operator of a well, or well field superintendent, or a position of equivalent responsibility, or having overall responsibility for environmental matters for the company; and
 - (iii) the written authorization is submitted to the Commission.
 - e. If an authorization under paragraph (d) of this section is no longer accurate because a different individual or position has responsibility for the overall operation of the facility, or overall responsibility for environmental matters for the company, a new authorization satisfying the requirements of paragraph (d) of this section must be submitted to the Commission prior to or together with any reports to be signed by an authorized representative.
5. Provide the name of a person who is thoroughly familiar with the facts reported on this form and who can be contacted by the Control Authority (e.g., the plant manager).

SECTION B – INSTRUCTIONS (BUSINESS OPERATIONS)

1. Check off all operation that occur or will occur at your facility. If you have any questions regarding how to categorize your business activity, contact the Control Authority for technical guidance.
3. For all processes found on the premises, indicate the Standard Industrial Classification (SIC) Code Number, as found in the most recent Edition of Standard Industrial Classification Manual prepared by the Executive Office of the President, Office of Management and Budget. This document is available from the Government Printing Office in Washington D.C., or in San Francisco, California. **DO NOT USE PREVIOUS EDITIONS OF THE MANUAL.** Copies of the manual are also available at most public libraries.
4. List the types of product, giving the common or brand name and the proper or scientific name. Enter from your records the average and maximum amounts produced daily for each operation for the previous calendar year, and the estimated total daily production for the calendar year. Be sure to specify the daily units of production. Attach additional pages as necessary.

SECTION C – INSTRUCTIONS (WATER SUPPLY)


4. Provide daily average water usage within the facility. Contact cooling water is cooling water that during the process comes into contact with process materials, thereby becoming contaminate. Non-contact cooling water does not come into contact with process materials. Sanitary water includes only water used in restrooms. Plant and equipment washdown includes floor washdown. If sanitary flow is not metered, provide an estimate based on 15 gallons per day (gpd) for each employee.

SECTION E – INSTRUCTION (WASTEWATER DISCHARGE INFORMATION)

1. **If you answer “no” to this question, skip to Section I, otherwise complete the remainder of the application.**

4. A schematic flow diagram is required to be completed and certified for accuracy. Assign a sequential reference number to each process starting with No. 1. An example of a drawing is shown below in Figure 1. To determine your average daily volume and maximum daily volume of wastewater flow, you may have to read water meters, sewer meters or make estimates of volumes that are not directly measurable.

Figure 1. SCHEMATIC FLOW DIAGRAM

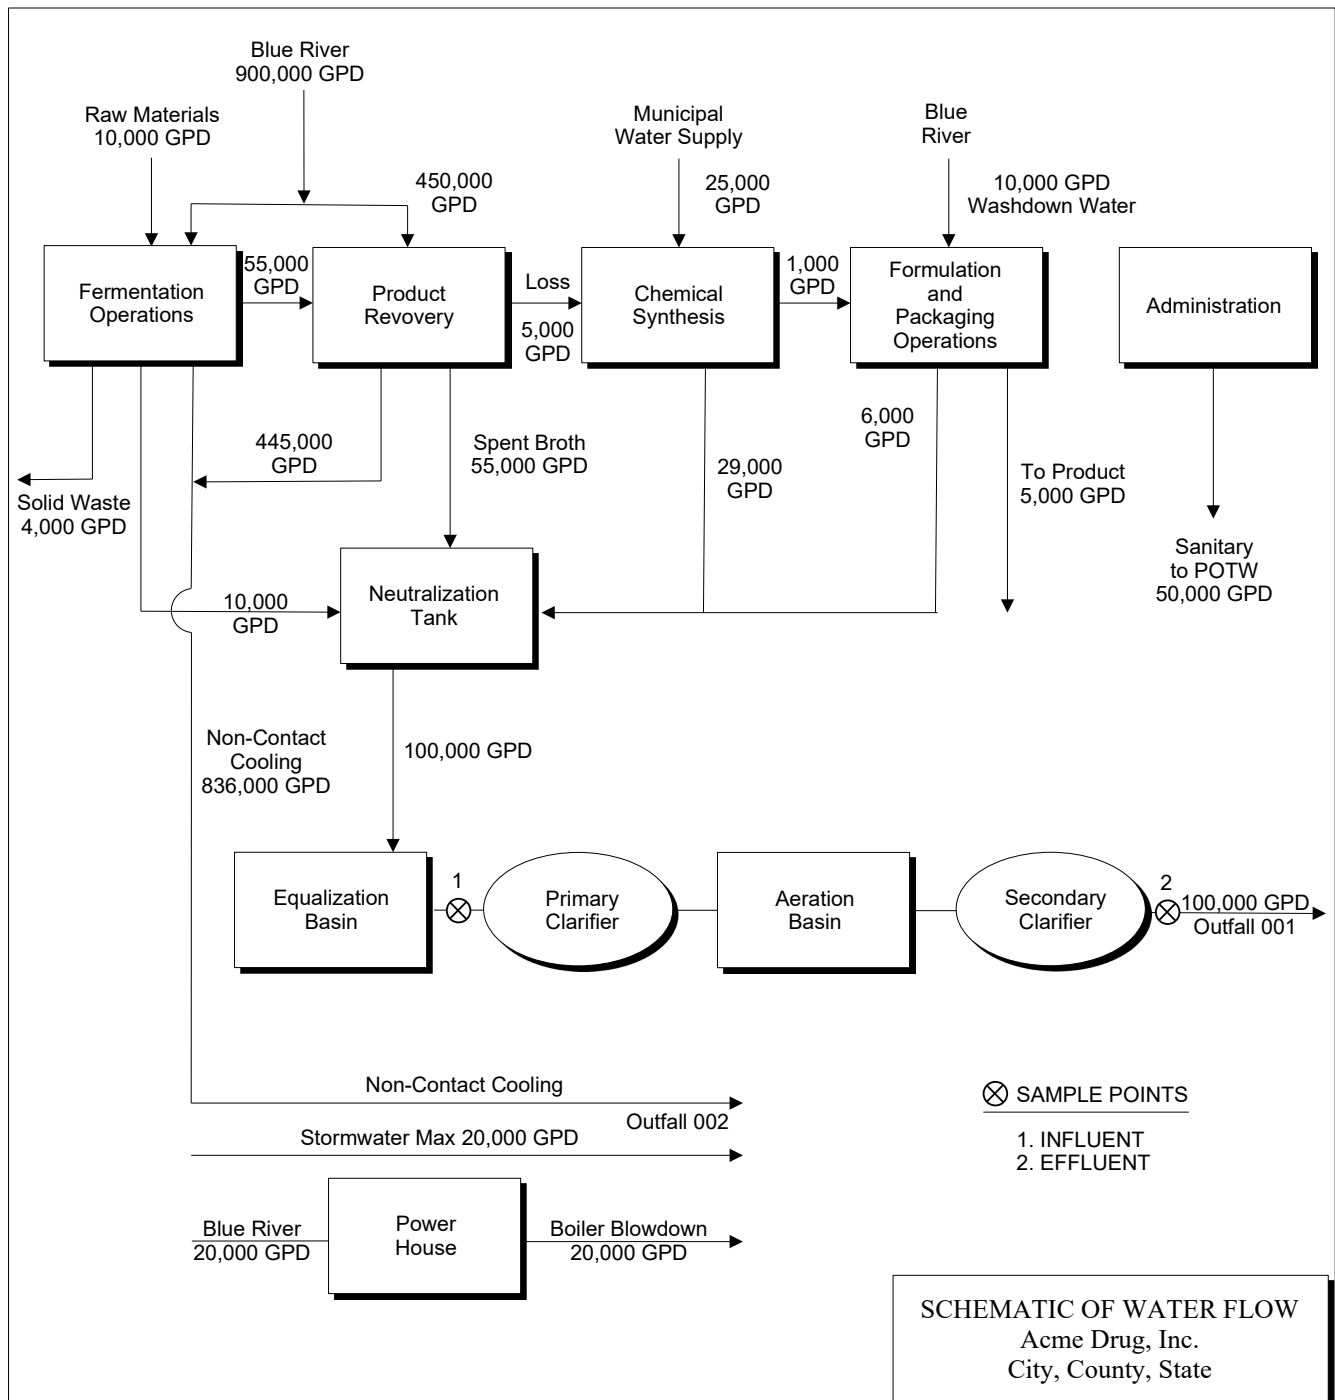


5. **Non-categorical users** should report average daily and maximum daily wastewater flows from each process, operation, or activity present at the facility. Categorical users should skip to question 6.
6. **Categorical users** should report average daily and maximum daily wastewater flows from every regulated, unregulated and dilution process. A regulated wastestream is defined as wastewater from an industrial process that is regulated for a particular pollutant by a categorical pretreatment standard. Unregulated wastestreams are wastestreams from an industrial process that are not regulated by a categorical pretreatment standard and are not defined as a dilution wastestream. Dilution wastestreams include sanitary wastewater, boiler blowdown, noncontact cooling water or blowdown, stormwater streams, demineralizer backwash streams and process wastestreams from certain industrial subcategories exempted by EPA from categorical pretreatment standards. [For further details see 40 CFR 403.6 (e).]
7. Total Toxic Organics (TTO) means the sum of the masses or concentrations of specific toxic organic compounds found in the industrial user's process discharge. The individual organic compounds that make up the TTO value and the minimum reportable quantities differ according to the particular industrial category (see applicable categorical pretreatment standards, 40 CFR Parts 405-471).

SECTION H – INSTRUCTIONS (FACILITY OPERATIONAL CHARACTERISTICS)

2. Indicate whether the business activity is continuous throughout the year or if it is seasonal. If the activity is seasonal, select the months of the year during which the discharge occurs. Make any comments you feel are required to describe the variation in operation of your business activity.
4. Indicate any shut downs in operation which may occur during the year and indicate the reasons for shutdown.
5. Provide a listing of all primary raw materials used (or planned) in the facility's operation. Indicate amount of raw material used in daily units.
6. Provide a listing of all chemicals used (or planned) in the facility's operations. Indicate the amount used or planned in daily units. Avoid the use of trade names of chemicals. If trade names are used, also provide chemical compounds. Provide copies of all available manufacturer's safety data sheets for all chemicals identified.

7. A building layout or plant site plan of the premises is required to be completed and certified for accuracy. Approved building plans may be substituted. An arrow showing North as well as the map scale must be shown. The locations of each existing and proposed sampling location and facility sewer line must be clearly identified as well as all sanitary and wastewater drainage plumbing. Number each unit process discharging wastewater to the public sewer. Use the same numbering system shown in Figure 1, the schematic flow diagram. An example of the drawing required is shown below.

FIGURE 2. BUILDING LAYOUT

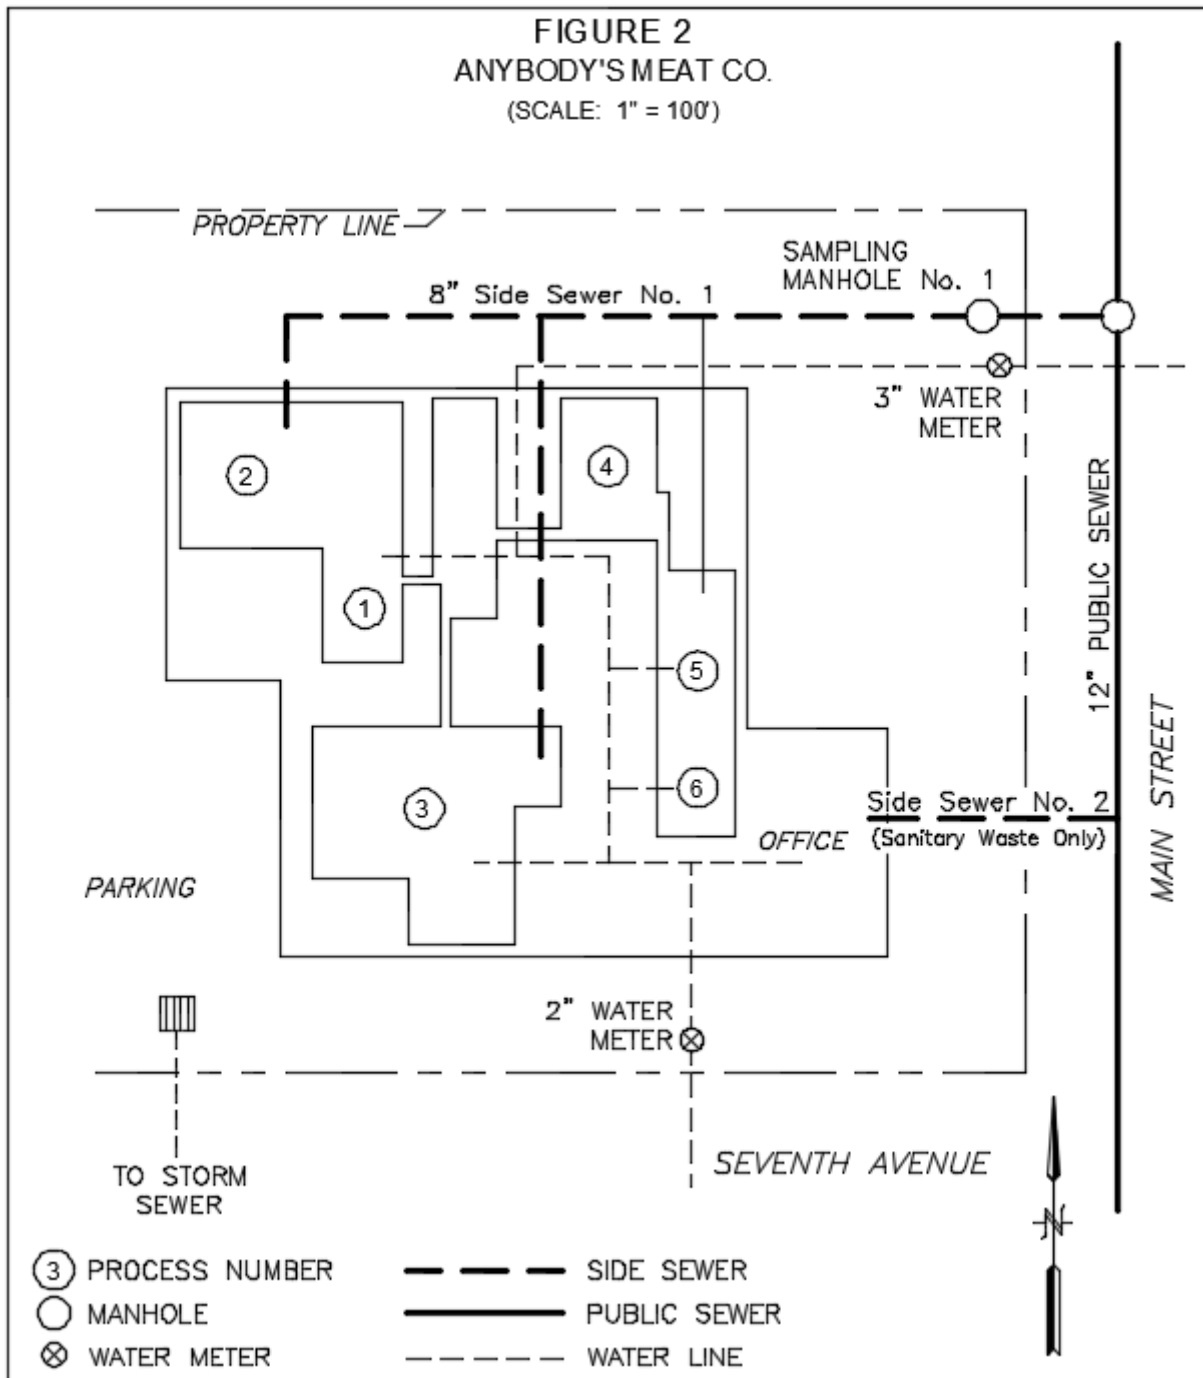

SECTION I – INSTRUCTIONS (SPILL PREVENTION)

5. Describe how the spill occurred, what was spilled, when the spill happened, where it occurred, how much was spilled and whether or not the spill reached the sewer. Also explain what measures have been taken to prevent a reoccurrence or what measures have been taken to limit damage if another spill occurs.

SECTION J – INSTRUCTIONS (NON-DISCHARGED WASTES)

1. For wastes not discharged to the Control Authority's sewer, indicate types of waste generated, amount generated, the way in which the waste is disposed (e.g., incinerated, hauled, etc.) and the location of the disposal.
2. Onsite disposal system could be a septic system, lagoon, holding pond (evaporative type), etc.
5. Types of permits could be: air, hazardous waste, underground injection, solid waste, NPDES (for discharges to surface water), etc.

SECTION K – INSTRUCTIONS (AUTHORIZED SIGNATURES)

See instructions for question 4 in Section A, for a definition of an authorized representative.